


PERMANENT CHANGES TO PLUMBING REQUIRES A PLUMBING PERMIT

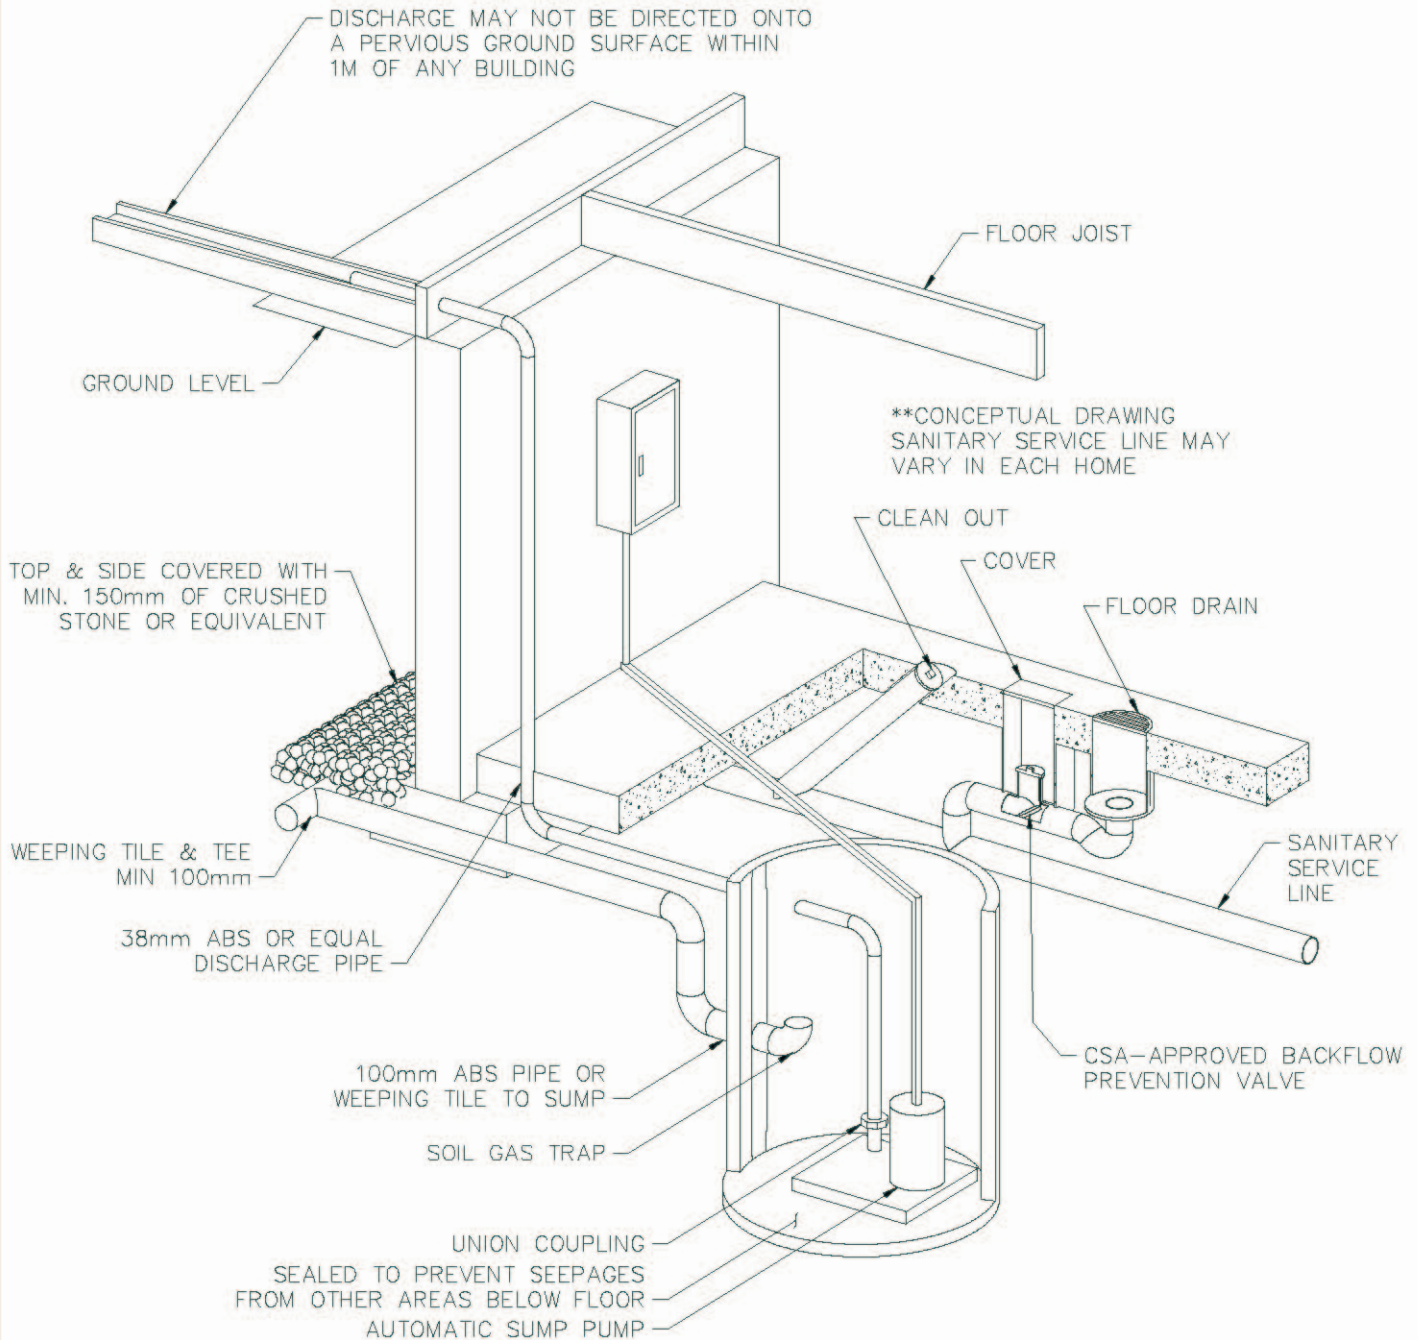

- ENSURE THAT THE SUMP IS A MINIMUM 1m FROM THE FOOTINGS.
- PROVISIONS REQUIRED TO PREVENT SOIL GAS FROM ENTERING THE DWELLING FROM THE SUMP AND WEeping TILE.

- SUMP PIT MAY BE CONSTRUCTED OF:
- A) CONCRETE
 - B) CORROSION RESISTANT STEEL
 - C) PLASTIC

CODE REFERENCE ON SUMP:
 NATIONAL BUILDING CODE SECTION 9.14.2
 FOUNDATION DRAINAGE
 9.14.5.2 SUMP PITS

- WHERE A SUMP PIT IS PROVIDED IT SHALL BE:
- A) NOT LESS THAN 750mm DEEP.
 - B) NOT LESS THAN 0.25sq.m IN AREA, AND
 - C) PROVIDED WITH A COVER.

| | | | |
|---|--|---|-------------------------------|
| REVISIONS |  | APPROVED | |
| 1 | | | GENERAL MANAGER _____ P. ENG. |
| 2 | | | ENGINEER _____ |
| 3 | | | ENGINEER _____ |
| DRAWN BY <u>C. CARTER</u> DATE <u>01/05/04</u> | | SUMP WITH PUMPED DISCHARGE TO SURFACE PLUS BACKFLOW PREVENTION | |
| CHECKED BY _____ DATE _____ | | SCALES : _____ HOR. NTS _____ PLAN NO. _____ FIGURE #2 | |